


Coolstores & cold storage risk management guide

Helping our customers stay in business by reducing risk

About NZI Risk Solutions

NZI has extensive experience in providing expert risk management advice to help our commercial customers remain in business. We have used this industry knowledge to develop a series of guides covering a range of risk management issues to help you take control of your business.

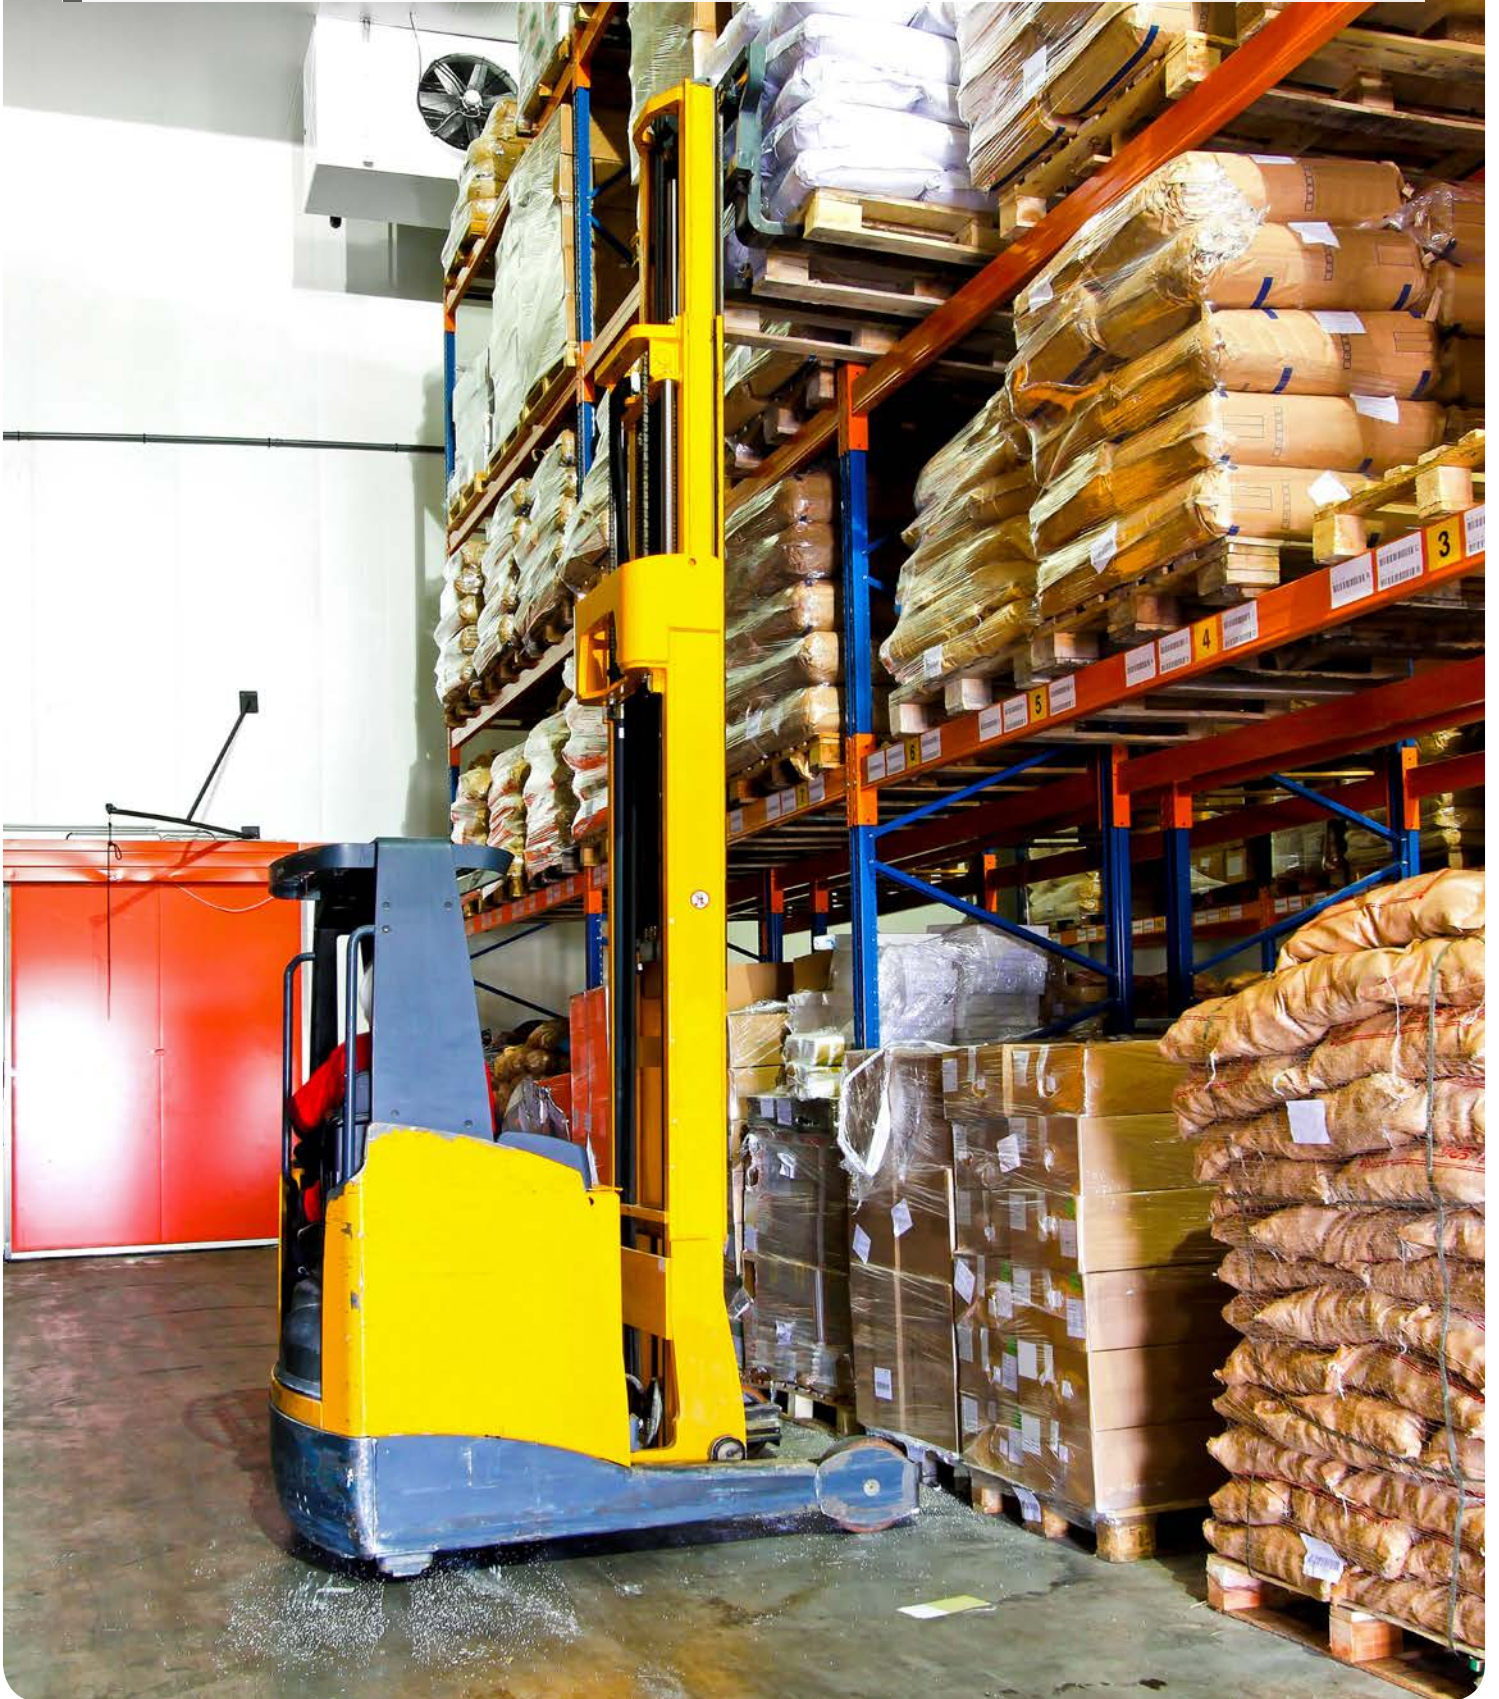

Contents

| | |
|---|----|
| Introduction | 2 |
| Addressing business risk | 3 |
| Developing a business continuity plan | 20 |
| Self-assessment risk management checklist | 21 |



Your business risk management guide

Many business owners are unaware of the numerous risks within their business and the effect these could have on their ability to continue trading. The real cost of a major loss incident is not only the direct loss or damage, but also the time spent dealing with the aftermath – including disruption to work and production schedules. Customer loyalty and business reputation can also be adversely impacted.

Risk management is critical to business survival

Risk management is critical to business survival. At NZI we want to share our risk management expertise with our business customers and, in particular, help them to address those risks associated with their buildings and assets.

As the owner of a coldstore business, what are some of the risks I need to be aware of?

In addition to monitoring plant to maintain the correct temperature range, the key risks for coldstores are fire, flooding and security. In terms of fire, it's not only the product that's at risk, but the packaging materials, storage systems and building materials, can also add to the fire load. Hot work (e.g. welding or angle grinding) undertaken in a coldstore situation is also a fire risk. Other important risk areas include: worker safety, material storage, the use of equipment like forklifts, electrical safety, and the use of environmentally hazardous substances. It's also important to have good risk management programmes in place to control risk related to general housekeeping, waste management and health and safety.

First things first – check your insurance policy and endorsements

When starting on your risk management journey, it's important to check your insurance policy and any endorsements that are applicable to it. Your policy and endorsements set out exactly what your insurer will pay for as a result of accidental loss, and what you are not insured for. It is particularly important that you understand any exclusions that may apply to your insurance policy. Having the right cover and adequate sum(s) insured is critical to your business surviving a significant loss.

If you have any questions it's important that you discuss these with your Insurance Advisor.



Addressing business risk – what to be aware of

The following pages include information about the most common areas of risk associated with coolstores or cold storage facilities as well as more general risks all businesses should be aware of.

Note: This guide uses the New Zealand Institute of Professional Engineers' (IPENZ) definition of refrigerated buildings as outlined here: "Coldstore, coolstore, chiller and freezer are all general descriptions of any refrigerated building constructed to cool product or keep it cool. These buildings are primarily used in New Zealand in the various food processing industries to retard bacterial degradation of food, that is, to preserve it. Pharmaceutical and photographic industries may also use coldstores."

Source: IPENZ Practice Note 15 – Coldstore Engineering in New Zealand.

Fire safety

Fire risk of expanded plastic insulated panel construction

Expanded polystyrene insulated panel (EPS) has been used as a building material in New Zealand for more than forty years. The product features a core of EPS with metal skins laminated on opposite sides creating a 'sandwich panel'.

This type of insulated panel is used extensively in buildings across the food industry. For instance, most modern supermarkets have freezers and coldstores using EPS, while some may also feature EPS in the external cladding and roofing of the building. A large proportion of the bars and restaurants in the hospitality industry also have coldstores that use EPS panels.

While EPS may be the practical choice for commercial builds, research shows it does not perform well in certain fires, which is a concern for fire safety and structural damage.

Source: BRANZ 'Improving the performance of Polystyrene Insulated Panel in New Zealand' – PCR Collier and GB Baker.

Fire risk of EPS construction

EPS is considered a high risk building material for commercial properties because polystyrene is a combustible thermoplastic that softens and melts when heated.

When it's involved in a fire, the core material melts. With its structural strength lost, the panels buckle allowing the joints to expand and the steel covering to delaminate. This results in a complete loss of the building's structural strength which means an almost certain collapse.

Buildings constructed from EPS panels can also cause major difficulties for fire fighters including:

- ▶ loss of the building's structural integrity
- ▶ production of heat, smoke and toxins that may require the evacuation of neighbouring residents
- ▶ rapid fire spread.

It's worth noting there are alternative insulated panel construction products available that are fire resistant and meet the requirements of New Zealand insurers and the Building Code.



Minimising fire risk in insulated panels

In order to minimise the risk of fires in foamed plastic insulated panels, we recommend you follow the guidelines below:

- ▶ Ensure there is no bare exposure of any plastic core (i.e. foamed polystyrene, polyurethane or polyisocyanurate foam), subsequent to the initial inspection.
- ▶ Repair any panel perforation (resulting in exposure of the plastic core) or other damage immediately.
- ▶ Keep all service penetrations through the panels sealed tight.
- ▶ Ensure all electrical wiring penetrations are in conduit.
- ▶ Ensure no potential exists for exposure of the plastic core to temperatures above 75°C.
- ▶ Obtain a fire report before installing any new hot flue, vent, duct etc.
- ▶ Arrange regular inspections of any grease/oil/solid particle flue, vent, duct or similar, and complete any necessary cleaning without delay.
- ▶ Arrange for a detailed annual inspection and maintenance report for all electrical wiring, lighting, other fittings and machinery items. Complete any necessary remedial action without delay.
- ▶ Ensure annual electrical inspection includes thermal imaging to detect hot spots. A registered electrician can carry this out.
- ▶ Consider using a non-combustible insulating panel type for all future building extensions or alterations.

General fire safety

Fire represents a significant risk for any business, but particularly coldstores that contain a wide variety of fire hazards. In addition, they use unique insulation systems that rely on foamed plastic panels that do not perform well in fires. A proven method of controlling a coldstore fire is with a properly designed and maintained automatic sprinkler system. However, it's important to have hand-operated fire extinguishers available as well.

The key elements of a well-planned fire protection system are outlined on the following pages.

Fire extinguishers and hose reels

Best practice for business premises is the installation of hand-operated fire extinguishers and/or hose reels.

Accidental fires are more likely to occur during working hours due to the greater use of electrical equipment, heating and normal processes.

Fire extinguishers should be installed by approved contractors and mounted on brackets with clear signage indicating their positions so they can be easily located in an emergency. They require annual servicing by approved contractors to ensure they remain ready for use and they should also be checked regularly by staff on site.

New Zealand Standards

NZS 4503:2005 Hand operated fire-fighting equipment, is the minimum standard for hand-operated fire fighting equipment in New Zealand. The other relevant Standard is NZS 1850:2009 Portable fire extinguishers – Classification, rating and performance testing.



It classifies and rates fire extinguishers to determine the appropriate type of extinguisher by fire type e.g. chemical fire or electrical fire etc.

All fire extinguishers should be selected, installed and maintained in accordance with these standards.

Using the correct fire extinguisher

Care should be taken to use the right type of fire extinguisher. Using the wrong fire extinguisher on certain fires can sometimes have disastrous results e.g. never use water extinguishers on burning liquids or oils or electrical fires.

Fire sprinkler systems and automatic fire detection systems

Sprinkler systems have become the most widely used and most reliable automatic means of fire protection.

Fire sprinkler systems automatically detect a fire, transmit an alarm to the Fire Service as a result of water flow and control or extinguish the fire. Sprinklers provide 24/7 fire protection as needed in the immediate vicinity of the fire.

Where a sprinkler system is installed in a temperature controlled environment, it is important that all rack flues (the clear vertical lines of sight from the floor to ceiling within rack storage areas) are kept clear of stored stock at all time.

There are a range of automatic fire detection systems that are suitable for temperature-controlled environments, including aspirating and linear heat detection systems. See your fire alarm agent for further advice. If your building is fitted with either a fire sprinkler system or a fire detection system, these should be maintained regularly by an approved agent.

Building warrant of fitness

The Building Act 2004 requires owners of buildings with specified systems (such as sprinklers, lifts and fire alarms) to provide the relevant council with an annual building warrant of fitness (WOF). The WOF confirms that the building's specified systems are being maintained and are operating effectively, and must be publicly displayed.

Regular fire drills

An orderly and efficient response to an emergency can be vital to the protection of property and the safety of people. It is strongly recommended that regular fire drills are held so that employees, volunteers and other regular visitors are aware of the procedure should an evacuation become necessary.

Well-performed fire drills will also help determine problems or danger areas, equipment problems or failures, knowledge of likely evacuation times and external meeting areas. Evacuation plans should then be posted internally for each building and, wherever possible, drills should be conducted with the knowledge and support of your local fire service.

Evacuation procedure

In the event of an emergency, the speed with which people can safely exit the building can mean the difference between life and death.

It is recommended that fire exits, doors relating to fire exits and paths of travel to fire exits, be routinely checked to ensure they are not obstructed or impeded in anyway. Checking of fire exits should form part of your regular hazard inspection regime, and notices providing clear instruction on how to evacuate and raise the alarm should be displayed at the main exit doors.



Hot work fire safety

There are a number of risk factors associated with hot work, including a high risk of fire.

Hot work includes: welding, flame cutting, disc cutting, grinding, blow lamps, brazing, burning off, soldering and the use of hot air guns. We've outlined a few key steps you can take to help prevent this type of fire on your premises.

Hot work permit

Before carrying out any hot work on site, a 'Hot Work Permit' should be issued. The person authorised to issue a permit (e.g. warehouse manager) should inspect the work area prior to releasing the permit and confirm all precautions have been taken in accordance with the New Zealand Standard 4781:1973 – Code of Practice for Safety in Welding and Cutting.

We recommend using the 'NZI Hot Work Permit Card', which is freely available from our Surveyors. This will help to easily identify fire hazards and take the necessary precautions.

Identifying hot work hazards

Here are a few key steps you can take to ensure you manage hot work fire safety effectively on your premises.

- ▶ Where possible, move the hot work object to a designated safe location, such as a welding bay.
- ▶ If the hot work object cannot be moved, relocate all movable fire hazards to a safe place.

- ▶ If the hot work object cannot be moved and if all fire hazards cannot be relocated, provide guards to confine the heat, sparks and slag, and protect the immovable fire hazards.
- ▶ Establish a 'Fire Watch Duty' and assign people key responsibilities for overseeing the hot work. Where possible, a fire hose should be available to use, if required.
- ▶ To eliminate the risk of fire, conduct a final check for hot spots 30 minutes after hot work is completed.
- ▶ For more detailed fire safety guidelines refer to the NZS 4781:1973 – Code of Practice for Safety in Welding and Cutting, Part 6.

Hot work precautions

The following factors must be considered before a hot work permit can be issued:

- ▶ Ensure hand-operated fire extinguishers or hose reels are readily available.
- ▶ Ensure manual fire alarm system, if installed, is operational.
- ▶ Ensure sprinkler system, if installed, is operational.
- ▶ Isolate automatic fire alarm detection system, if installed. Contact your fire alarm maintenance contractor to isolate the alarm.
- ▶ Train hot work operators to perform the work safely.
- ▶ Identify, isolate, remove, protect or disconnect all hazards, as appropriate.
- ▶ Restrain compressed gas cylinders.
- ▶ Maintain all equipment so it's in good working order.



Within 10 metres of hot work

These factors should also be considered to ensure the area within 10 metres of any hot work is managed appropriately:

- ▶ Sweep floors so they're clean and free from combustibles.
- ▶ Wet down combustible floors and cover with damp sand, metal or other shields.
- ▶ Remove any combustible material or liquids.
- ▶ Protect immovable combustibles with covers, guards or metal shields.
- ▶ Cover all wall and floor openings.

Hot work in confined spaces (tanks, containers, ducts, dust collectors etc.)

Be familiar with the hot work safety procedures in confined spaces. Ensure that anyone who welds, brazes, solders or gas cuts any container or pipe that has contained a combustible substance carries out the safety measures below.

- ▶ Hot work equipment is cleaned and all combustibles removed.
- ▶ Containers are flushed out and all flammable vapours extracted.

Hot work on foamed plastic panels (insulating panels)

Be familiar with these important safety steps when working on or near foamed plastic panels:

- ▶ Do not use heat producing cutting or drilling equipment directly on the panels.

- ▶ Where panels need to be cut, only use cold cutting methods such as shearing with hand operated tools at low speed or cooled/lubricated drills or hand saws.
- ▶ Do not use heated rods or similar to make small holes through the panel core.
- ▶ Equipment cannot be retro-mounted on panels unless it is bolted and supported properly.
- ▶ The panel core cannot be exposed. For example, all penetrations must be sealed and joint covers replaced as the job progresses.
- ▶ Remove all job waste and any combustibles immediately.

Hot work fire watch

Be aware of the post-hot work fire risks and apply these fire watch safety measures:

- ▶ Check for hot spots during and 30 minutes after any hot work is completed.
- ▶ Supply appropriate fire extinguisher(s) in the hot work area and, if possible, a fire hose should also be available.
- ▶ Provide fire fighting equipment training for personnel carrying out the hot work and those responsible for the fire watch. Ensure they know how to raise the alarm.

Provide a mobile phone or other suitable means for personnel to raise the alarm.



Flooding

Reducing potential flood damage

Planning ahead can dramatically reduce the impact of flooding on your business. For example, storing valuable items higher up reduces the likely loss at little or no cost.

In high-risk premises, consider investing in flood-protection products. There are many different types of flood protection products and your choice will depend on your level of flood risk and the potential costs of a flood to your business.

“Planning ahead can dramatically reduce the impact of flooding on your business. For example, storing valuable items higher up reduces the likely loss at little or no cost.”

Preventing flood and water damage to stock

It's important to know whether your business is in an area prone to flooding. If it is, it's especially important to stack key items on higher racks and protect electrical equipment, which is particularly vulnerable.

Flash flooding can cause substantial damage which may be avoided by carrying out some simple steps:

- ▶ Keep stock off the floor.
- ▶ Clean external drains of leaves, vegetation and other waste regularly.
- ▶ Ensure that all internal drains are also cleaned regularly.
- ▶ Check external guttering regularly – a few leaves blocking downpipes can cause a lot of flooding.

Some other actions to reduce the likelihood of flood damage to stock and electrical supply include:

- ▶ Prevent water entering the building by installing permanent or removable barriers to seal doors, windows and other openings.
- ▶ Fit non-return valves on drains and pipes.
- ▶ Raise electrical sockets to keep them clear of possible flood water.
- ▶ Use flood-resistant materials in the construction of new buildings or extensions to reduce the damage if a flood does occur.

Taking steps to delay or prevent flood water from getting in limits the damage and makes cleaning up easier and faster.



Security

Like any place of business, coldstores can be a target for burglary, theft and pilferage.

Coldstores can be subject to both internal and external theft. Internal thefts can be committed by company employees, contractors and other visitors who have a legitimate reason to be in the coldstore at certain times. External thefts are committed by people outside of the company who have no legitimate reason to be in the coldstore.

Delivery drivers can also pose specific security risks. Drivers waiting while their vehicle is being loaded or unloaded can use this opportunity to gather up items.

Some suggestions for providing good security at coldstores are outlined below.

Clearly establish facility boundaries

- ▶ Use separate areas for dispatching and receiving goods. Where possible, provide physical barriers between these two areas.
- ▶ Where possible, provide a separately fenced yard area that encloses the coldstore dispatching and receiving doors.
- ▶ Establish a policy that prohibits personal vehicles from being driven into the shipping and receiving yard area.
- ▶ Keep the gate to the exterior yard area locked at all times when the coldstore is closed.
- ▶ Do not allow employee or visitor parking near coldstore shipping and receiving doors.

- ▶ Strictly limit the number of main exterior doors that can be used for employee entrance and exit. Avoid having entrance doors where they cannot be observed by staff.
- ▶ Provide audible exit alarms on all doors designated as emergency exit only doors.

Establish visitor sign-in registers

- ▶ Set up a visitor register and do not allow visitors or delivery drivers to wander throughout the coldstore.

Intruder alarms

Intruder alarms are designed to both protect the physical assets within unoccupied premises and provide a safer environment for staff. Intruder alarms deter theft and vandalism and enable a coordinated and rapid response when an alarm is activated.

Early detection of an intruder is best achieved by installing a combination of detection devices throughout your premises.

These could include:

- ▶ movement sensors
- ▶ break glass sensors
- ▶ vibration sensors
- ▶ duress and hold-up alarms
- ▶ door and window devices.

The key to a successful intruder alarm system is the careful selection and configuration of the control panel and detection devices to suit the level of risk and the physical environment. This maximises the ability to detect intruders and minimises unwanted false alarms.



Safes

If you have valuable items or cash that require storage in a safe, it is important to have a quality, leading-brand safe that meets CEN European standards and has UL Rated locks. Your safe should also be permanently and securely attached to the structure of the building, such as bolting it to the floor, solid walls or wall studs, or encasing it in concrete.

All quality safes are allocated an amount called a 'cash rating' which is the maximum amount of cash that should be stored in the safe at any given time. If you are holding more cash than the cash rating of your current safe then you should consider upgrading it.

“Early detection of an intruder is best achieved by installing a combination of detection devices throughout your premises.”



Worker safety

While this guide is specifically focused on the buildings and assets of a business, it is impossible to ignore the fact that the modern coolstore can be a dangerous work environment. Common injuries for many coolstore and cold storage workers include those caused by slips, trips and falls. However, forklifts alone pose the biggest danger. New Zealand health and safety law requires business owners to provide specialised training for forklift drivers as well as material handling safety to decrease the likelihood of coolstore-related worker accidents.

Health effects of cold stress

Low temperatures, wetness and air movement are stress factors associated with working in cold environments that can lead to a condition referred to as 'cold strain'. Cold strain is often exhibited by employees in a variety of medical symptoms. If the degree of cold stress is slight, the resulting effects will probably be minor, but greater cold stresses can result in serious harm or even death to those exposed to them.

In any workplace where employees may be exposed to cold working environments, employers must ensure the appropriate protective and control measures are taken.

The most likely situations where cold stress could develop are where employees are working:

- ▶ outside in winter or at altitude
- ▶ in wet conditions
- ▶ inside walk-in freezers.

The colder the environment, the more adverse the health effects observed. Cold stress, like heat stress, impairs the ability to carry out both manual and mental tasks.

As the temperature drops, the sensitivity and dexterity of fingers lessens. At lower temperatures still, deeper muscles are affected, reducing muscle strength and stiffening joints. Cold-related discomfort also affects mental alertness. For these reasons, accidents are more likely to occur under cold working conditions.

Source: Guidelines for the management of work in Extremes of Temperature – Department of Labour

Worker safety risk management procedures

Creating a safety culture for those working within a coolstore is important. Coolstore workers are independent people, often working without direct supervision as they go about their daily work activities. Holding regular safety committee meetings and reviewing accidents or 'near miss' incidents are important activities to help embed safety as a business as usual activity.

Some risk management procedures that coolstore owners and operators can use to help prevent worker injuries (and at the same time help build a safety culture), are listed on the following pages.

Warm clothing & frequent breaks

It's important that coldstore workers wear warm clothing and take frequent breaks to allow their bodies to acclimatise. Specific insulated clothing and accessories, such as gloves, are available for this purpose.



Forklifts

- ▶ Train, evaluate and certify all operators to ensure they can operate forklifts safely.
- ▶ Regularly maintain forklifts, including tyres.
- ▶ Before using a forklift, examine it for hazardous conditions which would make it unsafe to operate.
- ▶ Follow safe procedures for picking up, putting down and stacking loads.
- ▶ Drive safely, never exceed speed limits and slow down in congested areas or those with slippery surfaces.

Materials storage

When thinking about safety issues associated with coldstores, it's the hazards involved in using equipment like forklifts or the dangers of lifting heavy materials that usually come to mind. While these issues pose significant threats, the way materials are stored can also impact safety.

If stacked incorrectly, products, raw materials and other supplies can fall and cause minor injuries like cuts and bruises, and even more serious injuries related to crushing or pinning. Employers need to make sure coldstore workers follow a set of best practice methods for the storage of materials to avoid these accidents, including:

- ▶ stacking loads evenly and straight
- ▶ placing heavier loads on lower or middle shelves
- ▶ removing one object at a time from shelves
- ▶ keeping aisles and passageways clear and in good repair.

Manual lifting/handling

Employers should ensure they:

- ▶ provide general ergonomics and task-specific training
- ▶ minimise the need for lifting through good design and engineering techniques
- ▶ encourage staff to lift properly and get a co-worker to help if a product is too heavy.

Good housekeeping

To help prevent slips and trips it is wise to eliminate loose material, spilt liquids, unnecessary steps, and boxes from the floor and dark areas with poor lighting. In addition, it's important to use anti-slip floor tape.

Loading docks

- ▶ Drive forklifts slowly on docks and dock plates.
- ▶ Secure dock plates and check if the plate can safely support the load.
- ▶ Keep clear of dock edges and never back up forklifts to the dock's edge.
- ▶ Provide visual warnings near dock edges.
- ▶ Prohibit 'loading dock jumping' by employees (jumping down off the loading dock).
- ▶ Ensure that dock ladders and stairs meet Building Code safety specifications.



Material storage

Stacking and shelving hazards

The Canterbury earthquakes demonstrated the importance of ensuring that storage racking systems and shelves are designed and maintained to withstand seismic activity.

Because many regions of New Zealand are susceptible to earthquakes, bulk storage facilities and retail stores should consider the restraint of contents as part of their hazard identification and maintenance programmes.

Restraint of building contents

The standard for Seismic Restraint of Building Contents, NZS 4104:1994, requires the restraint of building contents in certain conditions. The standard provides considerable detail and building owners and employers should make themselves aware of its requirements.

Shelving and racking systems

Shelving and racking systems should be designed and maintained so they can withstand the effects of an earthquake. Items stored above 1.2 metres high and weighing more than 5kg must be restrained in order to prevent them from falling onto the ground or personnel working beneath.

The Department of Labour recommends that employers should engage a consulting engineer to review the verification and certification of their shelving systems to ensure they meet the requirements of NZS 4219:2009 – Seismic Performance of Engineering Systems in Buildings, which contains the current state of knowledge on the topic.

The relevant design standards for shelving/racking systems are:

- ▶ NZS 1170.5:2004 – Structural Design Actions – Earthquake Actions – New Zealand
- ▶ NZS 3404.1:1997 – Steel Structures
- ▶ The BRANZ Design Guide – Seismic Design of High Level Storage Racking Systems with Public Access.

Regular checks of shelving systems should be undertaken to look for damage from forklifts or trolleys, missing bolts and bent steel supports or shelves.

Palletised goods

In frequently occupied areas (defined by the Seismic Restraint of Building Contents standard), palletised goods should be restrained to prevent them from creeping and/or falling from the racking system.

In order to reduce any toppling effect, the height of shrink-wrapped pallets should not exceed two times their base.

Shrink wrapping should extend around the base of the pallet so the goods and the pallet form one unit. Pallets should be in good condition – broken pallets should be removed from service.

Hazardous substances

Extra care needs to be taken when shelving hazardous substances. If incompatible hazardous substances fall from shelving in an earthquake and their packaging is breached, chain reactions such as the release of hazardous gases or sparks leading to a fire could occur.



In addition:

- ▶ Keep extra supplies of hazardous substances in segregated areas
- ▶ Keep filled gas cylinders stored as close to the ground as possible, or securely enclosed in a cage or similar that allows air to circulate through.

“An overlooked dent in a pallet rack, which may appear as a cosmetic flaw, can easily result in a costly rack collapse.”

Heavy items stored below two metres in open shelving

Certain supplies of stock, such as shrink-wrapped, canned or bottled goods, are heavy enough to cause serious injuries or death if they fall off shelves onto workers or shoppers.

Heavy or solid items should not be stacked more than 1.2m high without restraint to prevent causing injury during an earthquake. Heavy items must not be stored near frequently occupied areas or near doors/exits to prevent blockage during an earthquake.

Source: Disaster Recovery, ‘Stacking and Shelving Hazards’ Fact Sheet, Department of Labour

Pallet racking storage safety

Damage to pallet racking is often underestimated and can put workers in danger when not properly maintained. It can be difficult to detect damaged pallet racks at a glance so it's important to schedule regular inspections of this type of storage equipment by a professional company. An overlooked dent in a pallet rack, which may appear as a cosmetic flaw, can easily result in a costly rack collapse.

Pallet rack failure

The six most common causes of pallet rack failure are:

1. Damage from forklifts
2. Overloaded racks
3. Altered rack configuration
4. Change in operation (rack layout re-arrangement)
5. Incorrect equipment use
6. Faulty equipment.

Tips for preventing injuries to workers and product damage in pallet racking include:

- ▶ Stack loads evenly and straight on shelves
- ▶ Place heavier loads on lower or middle shelves
- ▶ Remove one object at a time from shelves
- ▶ Keep aisles and passageways clear and clean.

Caution: Do not try to change or repair pallet racking yourself, including cutting, welding, modifying, rearranging or adding other components. Replace damaged racks immediately using professional, experienced contractors.



Battery safety

For electric forklifts and lift vehicles

Battery safety is important. Although batteries are designed to be extremely safe, trained staff must always be observant and cautious as battery acid is both toxic and corrosive. It is important that safety precautions are taken when handling batteries, these include:

- ▶ always have a 'Battery Charging Safety Checklist' displayed in the charging area
- ▶ wear protective eye/ face visors and acid-resistant PVC clothing – note that acid will eat through cotton
- ▶ wear protective gloves
- ▶ make sure that people charging batteries have been properly trained.

Lift vehicle battery charging fire risks


There are fire risks associated with charging or recharging of batteries. The predominant causes of these fires are:

- ▶ evolution of hydrogen, a highly flammable gas
- ▶ overloading of electrical circuits
- ▶ overheating of electrical components
- ▶ earth leakage faults
- ▶ corrosion from spilt acid causing deterioration of electrical apparatus.

Minimising the potential for fires during battery charging

Below are some simple steps to minimise the potential for fires to occur during battery charging:

- ▶ Always have a 'Hazard Warning Notice' displayed in the charging area.
- ▶ Preferably, carry out charging in a dedicated room of fire resistant construction. This room should not be a basement.
- ▶ Maintain a clear one metre space between the battery charger and the lift vehicle.
- ▶ Provide good high-level and low-level ventilation in the room. Ventilate directly to the outside of the building.
- ▶ Provide serviced hand-held fire extinguishers within the charging area – minimum 2kg dry powder.
- ▶ Provide lime or soda ash close by to enable prompt neutralising of any spilt acid.
- ▶ Keep all switch contacts and connecting blocks clean, especially where exposed to the atmosphere.
- ▶ Regularly inspect and maintain all electrical equipment. Pay particular attention to flexible cables and current limiting resistors.
- ▶ Because of the risk of electrical arcing, keep the quantities of combustible materials in the proximity of the charger to a minimum. Remove any waste such as rags, paper and packaging materials daily.
- ▶ Where recharging of lift vehicle batteries takes place, provide a three metre 'no go' area (or fire break) where the storage of combustible materials is prohibited.
- ▶ Use yellow hatch markings around the battery charging area to make it clear nothing should be stored there.

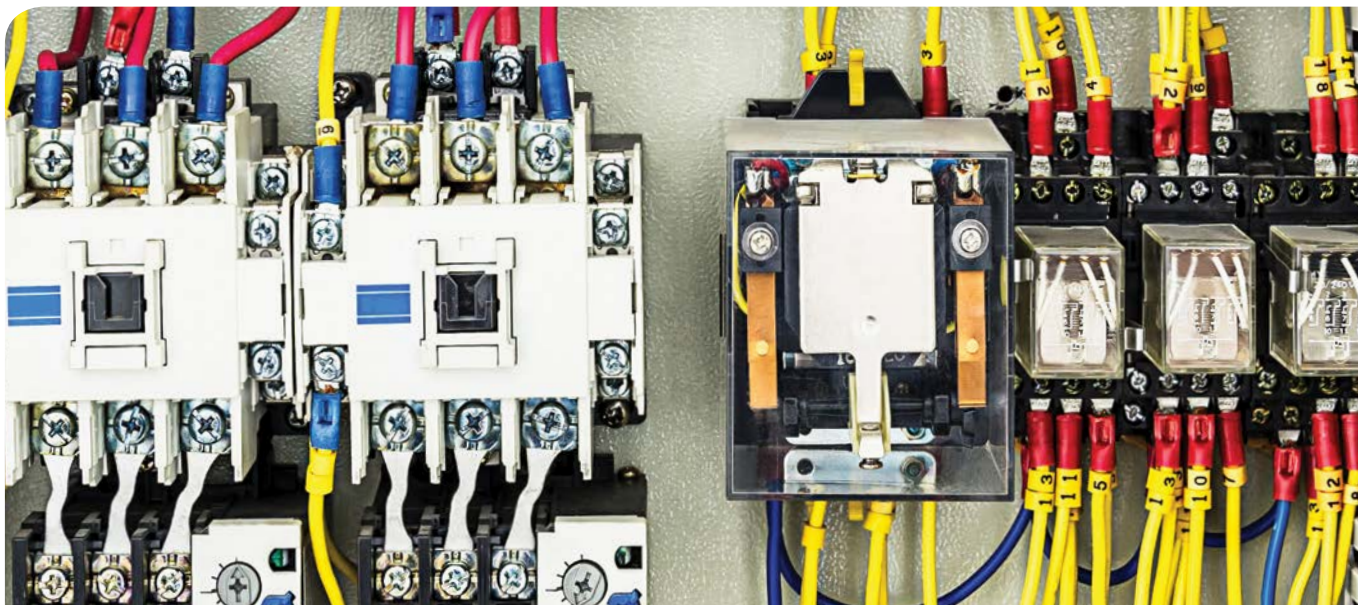

Electrical safety

Electrical fires make up a high percentage of fire insurance losses and are often the result of a large scale fire incident. Fires are commonly caused by loose electrical connections, weakening of insulation and poor maintenance of electrical equipment. Legislation requires specific preventative action such as disconnecting, isolating and making safe any defect which constitutes an electrical hazard to persons, livestock or property.

The need for electrical installation inspection and maintenance

All electrical installations need regular maintenance. Switchboards wear and need replacement as time progresses and demands on the installation change. Equally, network system upgrades can affect fault-trip levels.

Related electrical shortcomings continue to account for a high number of fire losses in New Zealand. To minimise the potential for such losses, it is necessary to complete regular and ongoing inspection and maintenance, which can include thermographic image testing.

Electrical safety inspection items classified as 'requiring urgent attention' means the safety of those using the installation may be at risk and arrangements should be made for a suitably qualified person to undertake the necessary remedial work without delay.

Electrical test and tag regime

Testing and tagging of plug-in electrical appliances is a requirement of the Electrical (Safety) Regulations 2010. The New Zealand Standard AS/NZS 3760 outlines the requirements for electrical appliance testing. Best practice requires that an asset register is set up that contains test results, failed items, repaired and out of service items, and lists of items that are exempt from testing. The register is important proof that your business is compliant with current health and safety regulations and keeps you up-to-date with the condition of your equipment. For more information visit www.energysafety.govt.nz

“Electrical fires make up a high percentage of fire insurance losses and are often the result of a large scale fire incident.”

Electrical regulatory safety obligations

Under health and safety legislation, business owners and operators have a responsibility to ensure a safe work environment for all employees and visitors. The Electricity (Safety) Regulations 2010 specify a range of documentation that should be kept on site to record electrical work on electrical systems (including electrical system maintenance). Take a look at your record management practices to ensure they're up-to-date and compliant.



Storage and handling of environmentally hazardous substances

All companies have a responsibility to make sure that any environmentally hazardous substances are handled and stored correctly.

The Environmental Protection Authority

The Environmental Protection Authority (EPA) administers, monitors and reports on the effectiveness of the Hazardous Substances and New Organisms (HSNO) Act. They also compile and report data on incidents involving hazardous substances and new organisms. The HSNO Act allows the Authority to conduct inquiries into any incident.

“Make sure that all hazardous substances are labelled correctly.”

Keys to best practice handling and storage of hazardous substances

- ▶ Store all hazardous substances correctly.
- ▶ Make sure that all hazardous substances are labelled correctly.
- ▶ Segregate substances when required.
- ▶ Use correct procedures when dispensing.
- ▶ Isolate exposures with ventilators at source.
- ▶ Make sure you use the right safety equipment.
- ▶ Have emergency plans in place.
- ▶ Always dispose of hazardous waste in accordance with the law.

Note that the HSNO Act requires personnel handling or using hazardous substances in quantities above set trigger limit levels, or regulated degrees of hazard, to be certified as ‘Approved Handlers’. You should also check with the EPA whether you require a HSNO Hazardous Substances Location Test Certificate.



Risk management programmes

Good housekeeping plans

Keeping premises tidy is vital to reducing risk. Having a good housekeeping plan (and regularly carrying it out) may save your business from a major loss. Regular housekeeping not only reduces risk in your business, but also helps to create an efficient workplace and a pleasant environment for staff and customers.

General maintenance plan

Your maintenance plan will relate directly to your type of business and usually includes all of your machinery and equipment. Note that your equipment also includes all of your office equipment such as computers and communication devices.

Remember that your general maintenance plan should also include your building. Regardless of whether you are a tenant or building owner, it's important to have a plan that regularly checks all areas of your building e.g. gutter cleaning (to prevent flooding) and roof inspections (in case of losses due to high winds and/or heavy rain).

Health and safety

New Zealand's health and safety system has been completely reformed. The Pike River Mine disaster was the catalyst for the programme of change that created the Health and Safety at Work Act 2015. The aim of the law is to reduce the number of New Zealanders killed or hurt at work.

One of the key aspects of the legislation is the allocation of duty and responsibility. The primary duty for ensuring workplace health and safety is allocated to a 'Person Conducting a Business or Undertaking', a PCBU. Business owners are considered to be a PCBU and will have immediate responsibilities to the health and safety of workers directly engaged by them and others who have contact with the business.

The law says a PCBU needs to take reasonably practical steps to manage health and safety risks. How this is done will depend on: how seriously someone could get hurt, the chance of an accident happening and how much control there is over preventing it.

See www.business.govt.nz/worksafe for further information.



Rubbish skips and wheelie bins

Every year the New Zealand Fire Service attends hundreds of fires that have spread from nearby rubbish skips and bins. These fires are almost always deliberately lit and result in significant costs in property loss, injuries and loss of business. In dollar terms the indirect economic loss is about \$100m annually. Rubbish stored in skips or bins near buildings is an easy target for opportunists seeking to start a fire. These fires can quickly spread to your building, plant and other equipment associated with your business, threatening your trade temporarily or permanently.

The New Zealand Fire Service has provided a nine point checklist to help reduce the risk of rubbish fires damaging your business as follows:

1. Locate bins well away from buildings.
2. Store combustible waste in metal rubbish containers with self closing lids.
3. Products and materials that need to be stored outside must be in limited pile sizes and well away from buildings, inside and outside the boundary fences.
4. Arrange to have waste collected weekly to minimise rubbish on site at weekends.
5. Ensure public access to your building and yards is limited.
6. Define safe designated smoking areas for staff.
7. Lock bin lids when not in use.
8. Install and maintain adequate perimeter fencing and lock and secure property at night.
9. Provide security lighting and surveillance equipment.

Source: 'Preventing rubbish fires. Fire safety advice for businesses'.
NZ Fire Service FS1522

Wooden pallet storage

It is extremely important that wooden pallets are not stored against a building. NZI recommends they are stored at least 10 metres away from any building. Fires are often deliberately lit in pallets by arsonists.

When pallets are stored too close to commercial premises they threaten the safety of the building should a fire start. If the 10 metre rule cannot be physically met you should store idle pallets as far away as practical from the building.

Smoking policy and controls

We are constantly reminded that smoking is a health hazard. However, it's also important to remember that smoking can cause fires leading to loss of life and property damage.

Make it clear to staff and visitors what the smoking policy is and why it has been implemented. While signage can be instructive, it is not enough to ensure that smoking will be appropriately controlled. Make sure your smoking policy is included in your site induction training.

When visitors sign-in are they given instructions on your smoking policy? If you permit smoking at your facility it's important that you provide suitable controls to prevent fire. Designated smoking areas are a common means of providing such a control. Make sure that smoking areas are fitted with ash trays and are located well away from materials that can burn, including vegetation.



Developing a business continuity plan

A business continuity plan (BCP) is one of the best investments any business can make and is one of the most critical components of any recovery strategy. A BCP details how to get your business back on track after a disruption in the most effective way possible. The main objective of a BCP is to recover all business critical processes and minimise the impact for employees, customers and your reputation.

From the Canterbury earthquakes to storms and flooding in Wellington and tornadoes in Auckland, companies that proactively consider how to respond to events are the first to get back to business, often at the expense of competitors. A predefined BCP, combined with the proper insurance coverage, maximises the chance of a successful recovery by eliminating hasty decision-making under stressful conditions.

Withstanding a major loss event

Did you know that 25 percent of businesses do not reopen following a major loss event? This is because it doesn't take a major catastrophe to shut down a business. In fact, seemingly minor disruptions can often cause significant damage such as power failures, broken water pipes, or loss of computer data etc.

What's in a business continuity plan?

A business continuity plan should contain all of the information you need to get your business up and running again after an incident or crisis. The size and complexity of the plan will depend on your business and good practice suggests it should form part of your overall business plan.

Generally a BCP will include a list of roles and responsibilities during an incident, an emergency response checklist and key contacts for all staff and for contractors and suppliers, including out-of-hours numbers.

Develop, implement and maintain

Developing the plan is the obvious first step, but implementing it is essential. Appointing a person who will ensure that a BCP is created, developed, tested and maintained is your best approach to this business critical activity.

“Given that twenty five percent of businesses do not reopen following a major loss event, a business continuity plan is one of the best investments you can make.”

*These guidelines and self-assessment risk management checklist are of a general nature only. They are not intended to be a comprehensive list of all the risk management steps you should consider taking to reduce the risk of damage and financial loss, nor is it intended to be legal advice.

Self-assessment risk management checklist

| Fire safety equipment | Yes | No |
|---|--------------------------|--------------------------|
| Do you have fire extinguishers or hose reels? | <input type="checkbox"/> | <input type="checkbox"/> |
| Is the annual servicing up-to-date? (Check the inspection tag on the extinguisher/hose reel) | <input type="checkbox"/> | <input type="checkbox"/> |
| Have you and your staff been trained to use fire extinguishers? | <input type="checkbox"/> | <input type="checkbox"/> |
| If you have a fire sprinkler system, is it serviced regularly? | <input type="checkbox"/> | <input type="checkbox"/> |
| If you have a fire alarm system, is it serviced regularly? | <input type="checkbox"/> | <input type="checkbox"/> |
| Hot work fire safety | Yes | No |
| Do you have safety procedures for all hot work (e.g. welding, flame cutting, disc cutting)? | <input type="checkbox"/> | <input type="checkbox"/> |
| Do you have copies of NZI Hot Work Permit Cards? | <input type="checkbox"/> | <input type="checkbox"/> |
| Flooding | Yes | No |
| Do you have a regular maintenance plan for cleaning gutters and drains? | <input type="checkbox"/> | <input type="checkbox"/> |
| Is your stock kept off the floor? | <input type="checkbox"/> | <input type="checkbox"/> |
| Do you have a recovery plan in case of flooding? | <input type="checkbox"/> | <input type="checkbox"/> |
| Security | Yes | No |
| Do you have a visitor sign-in register? | <input type="checkbox"/> | <input type="checkbox"/> |
| Do you have CCTV surveillance? | <input type="checkbox"/> | <input type="checkbox"/> |
| Do you have an intruder alarm? | <input type="checkbox"/> | <input type="checkbox"/> |
| Has the intruder alarm been serviced recently? | <input type="checkbox"/> | <input type="checkbox"/> |
| Is the intruder alarm monitored by an external monitoring company? | <input type="checkbox"/> | <input type="checkbox"/> |
| Do you have security patrols? | <input type="checkbox"/> | <input type="checkbox"/> |
| Do you have security locks on doors? | <input type="checkbox"/> | <input type="checkbox"/> |
| Do you have security locks on windows? | <input type="checkbox"/> | <input type="checkbox"/> |
| Are your valuable items and cash stored in a safe? | <input type="checkbox"/> | <input type="checkbox"/> |
| Worker safety | Yes | No |
| Do you have worker safety procedures for loading docks, forklifts, material storage, manual lifting and handling? | <input type="checkbox"/> | <input type="checkbox"/> |
| Do you have a regular training programme for all forklift operators? | <input type="checkbox"/> | <input type="checkbox"/> |
| Are your forklifts regularly inspected and maintained – including tyres? | <input type="checkbox"/> | <input type="checkbox"/> |
| Do you have a general ergonomics training programme for lifting and handling stored products? | <input type="checkbox"/> | <input type="checkbox"/> |
| Do you have a regular inspection and cleaning programme to eliminate loose or wet material on floors | <input type="checkbox"/> | <input type="checkbox"/> |

| Material storage | Yes | No |
|---|--------------------------|--------------------------|
| Are your shelving and racking systems designed and maintained to withstand the effects of an earthquake? | <input type="checkbox"/> | <input type="checkbox"/> |
| Are your heavy items stored below two metres in open shelving? | <input type="checkbox"/> | <input type="checkbox"/> |
| Have you checked your storage procedures and read the Department of Labour 'Stacking and Shelving Hazards' factsheet? | <input type="checkbox"/> | <input type="checkbox"/> |
| Battery safety for electric forklifts and lift vehicles | <input type="checkbox"/> | <input type="checkbox"/> |
| Do you have a designated area for safe battery charging with correct ventilation and safety checklist? | <input type="checkbox"/> | <input type="checkbox"/> |
| Do you have staff members trained in battery charging? | <input type="checkbox"/> | <input type="checkbox"/> |
| Has your electric forklift or lift vehicle been inspected and serviced within the past 12 months? | <input type="checkbox"/> | <input type="checkbox"/> |
| Electrical safety | Yes | No |
| Have you had an electrical safety check by a registered electrician in the last 12 months? | <input type="checkbox"/> | <input type="checkbox"/> |
| Do you have an electrical installation Certificate of Periodic Verification? | <input type="checkbox"/> | <input type="checkbox"/> |
| Storage and handling of environmentally hazardous substances | Yes | No |
| Do you have any hazardous substances on site? | <input type="checkbox"/> | <input type="checkbox"/> |
| Are the hazardous substances stored in a hazardous goods store? | <input type="checkbox"/> | <input type="checkbox"/> |
| Do you have HSNO-approved handlers for hazardous substances? | <input type="checkbox"/> | <input type="checkbox"/> |
| Do you require a HSNO hazardous substances Location Test Certificate? | <input type="checkbox"/> | <input type="checkbox"/> |
| Risk management programmes | Yes | No |
| Do you have a housekeeping programme? | <input type="checkbox"/> | <input type="checkbox"/> |
| Do you have a building maintenance programme? | <input type="checkbox"/> | <input type="checkbox"/> |
| Do you have a smoking control programme? | <input type="checkbox"/> | <input type="checkbox"/> |
| Do you have a waste management programme? | <input type="checkbox"/> | <input type="checkbox"/> |
| Do you have a health and safety programme? | <input type="checkbox"/> | <input type="checkbox"/> |
| Do you have a business continuity plan? | <input type="checkbox"/> | <input type="checkbox"/> |

NZI Risk Solutions™



www.nzi.co.nz

NZI, a business division of IAG New Zealand Limited.
NZI Risk Solutions™ is a registered trademark of IAG New Zealand Limited.